

**FLOW COMPUTERS  
MODELS 405D & 405B**





# CONTENTS

<b>1. Introduction</b>	<b>3</b>
1.1 Model Number Designation	4
<b>2. Specification</b>	<b>5</b>
<b>3. Operation</b>	<b>7</b>
3.1 Front Panel Operation	8
3.2 Calculation of Rate and Total	9
3.2.1 Frequency Input	9
3.2.2 Filtering	10
3.3 Total Conversion	12
3.4 The Output Pulse	13
<b>4. Options</b>	<b>15</b>
4.1 The 4-20mA Output Option	15
4.1.1 Load Specification	16
4.1.2 Calculation	16
4.2 The RS232/422/485 Interface Option	19
4.2.1 Hardware	19
4.2.2 Multipoint Communication	20
4.2.3 Communication Protocol	22
4.3 The Relay Output Option	24
<b>5. Calibration</b>	<b>25</b>
5.1 Programming the Setup Parameters	27
5.2 Programming Options	29
5.3 Checking the Input Signal	32

<b>6. Input Circuits</b>	<b>33</b>
6.1 Input Circuit for the Model 405D	33
6.2 Input Circuit for the Model 405B	38
6.3 Remote Switches	41
<b>7. Installation</b>	<b>42</b>
7.1 General	42
7.2 Wiring Designations for the 405D & 405B	44
7.3 Ex 410 Enclosure Dimensions	45
<b>8. Trouble Shooting</b>	<b>46</b>
8.1 Error Codes	46
<b>Index</b>	<b>47</b>

# 1. INTRODUCTION

The Models 405D and 405B Flow Computers accept pulse or frequency flow signals from a wide variety of flowmeters, and display Rate, a resettable Total and an accumulated Total.

This manual covers both the Model 405D and 405B. While both versions have identical software and outputs, the Model 405D has an input signal conditioning card, while the Model 405B accepts only basic pulse and squarewave signals.

Model 405D	Accepts most frequency and pulse signals, including mV outputs from turbine flowmeters, and 2 wire proximity switch outputs. It also enables all four front panel switches to be remotely connected via the rear terminal strip.
------------	--

The Model 405D has a scaled pulse output for driving remote counters.

Model 405B	Accepts basic pulse and squarewave signals only.
------------	--

Both instruments are fully programmable, with all calculation constants set via the front panel switches and stored permanently in a non-volatile memory.

This instrument conforms to the EMC-Directive of the Council of European Communities 89/336/EEC and the following standards:

<i>Generic Emission Standard EN 50081-1</i>	Residential, Commercial & Light Industry Environment.
---	---

<i>Generic Emission Standard EN 50081-2</i>	Industrial Environment.
---	-------------------------

<i>Generic Immunity Standard EN 50082-1</i>	Residential, Commercial & Light Industry Environment.
---	---


<i>Generic Immunity Standard EN 50082-2</i>	Industrial Environment.
---	-------------------------

In order to comply with these standards, the wiring instructions in Section 7.1 must be followed.

## 4 Introduction

### 1.1 MODEL NUMBER DESIGNATION

The Model number of an instrument describes which input and output options are installed and the AC mains voltage rating.

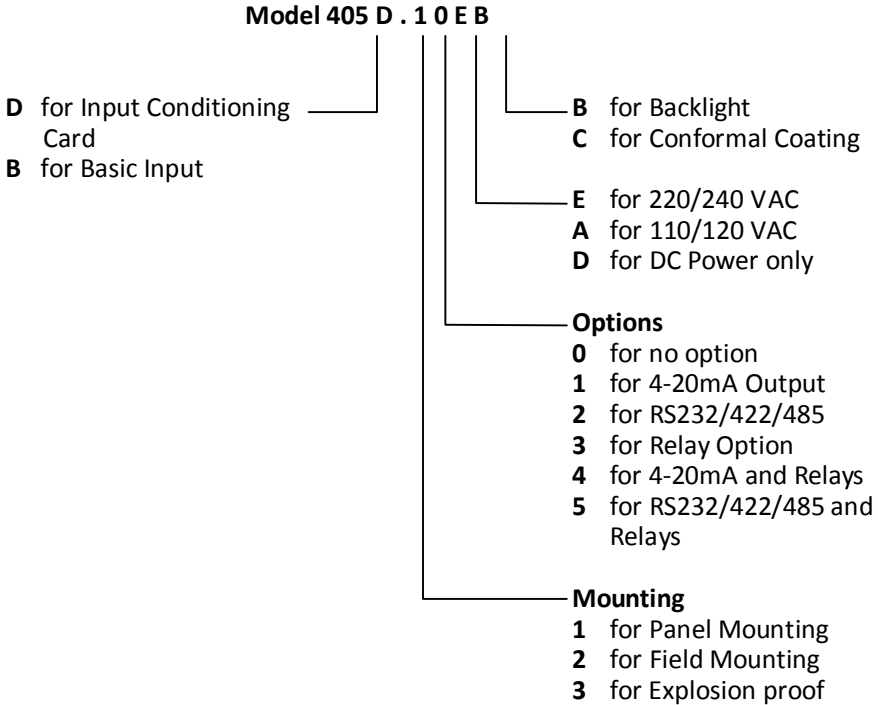

The Model number of the instrument is displayed on first entering the Calibration Mode (see Section 5).

## 2. SPECIFICATION

### *General*

Display:	6 digit LCD. 0.7" (17.8mm) high digits.
Display Update Rate:	0.25 seconds.
Transducer Supply:	8-24VDC field adjustable. 50mA maximum.
Power Requirements:	11.5 to 28.5 volts DC. 60mA typical current (no options). AC Mains: Set internally to 95 - 135 VAC or 190 - 260 VAC.
Operating Temperature:	0 to 55°C standard.
Dimensions:	5.7" (144mm) wide x 2.8" (72mm) high x 7.0" (178mm) deep.
Cutout:	5.5" (139mm) wide x 2.6" (67mm) high.

### *Frequency Input*

Frequency Range:	Minimum: 0.25Hz on Rate. 0Hz on Total.
Input Circuits:	Maximum: 10KHz. Will accept most sine logic and proximity switch inputs (see section 6.1).
Scaling Range:	0.1000 to 50,000.

### *Relay Outputs*

Maximum Switching Power:	1250VA.
Maximum Switching Voltage:	250VAC, 30VDC.
Maximum Switching Current:	5 Amps.

## 6 Specification

### **4-20mA Output**

Resolution:	10 bits.
Accuracy:	Better than 0.05%.
Maximum Load:	500 ohms internally powered from +15V (T26) 950 ohms from 24VDC or if internal to -15V (T26,T23)
Isolation:	Output is isolated.

### ***Pulse Output (Model 405D Only)***

Pulse Width:	10mSec (negative going pulse).
Maximum Duty Cycle:	49 pulses per second.
Output:	An open collector transistor will sink 100mA.
Scaling:	The pulse output is scaled and outputs one pulse each time the accumulated total increments.




# 3. OPERATION

The Models 405D and 405B use a low power CMOS microprocessor to perform all control functions and calculations.

Both the instruments are fully programmable with all operating parameters and calculation constants user programmable. (See Section 5 entitled "Calibration" for information on programming.) All parameters and constants are stored in a non-volatile memory which retains data without battery backup for a minimum of 10 years.

A block diagram of the instrument is shown below.

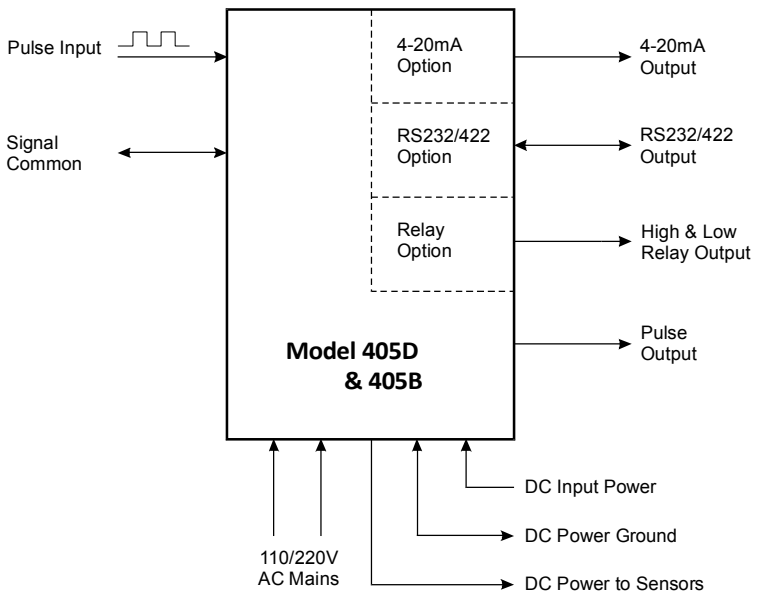

# 8 Operation

## 3.1 FRONT PANEL OPERATION

The display will normally show the Rate or resettable Total, as selected by the RATE or TOTAL keys on the front fascia. An LED in the key panel will light to indicate which function is currently displayed.

The DISPLAY key can be used to display the Accumulated Total. On the first press of the DISPLAY key, the display shows ACCTOT for one second followed by the actual total. The Accumulated Total continuously totalises the flow and is not resettable from the front panel.

On reaching the maximum displayed total, all totals will roll over to zero and continue totalising. If, at any time, power is lost or the instrument is switched off, the totals will be stored in the non-volatile memory. When power is switched back on to the instrument, the stored totals will be recalled from memory and the totals will be incremented from the last values.

## 3.2 CALCULATION OF RATE AND TOTAL

### 3.2.1 Frequency Input

The flowrate,  $R$ , is calculated as follows:

$$R = \frac{f \times H}{S}$$

- where  $f$  is the input frequency in Hz.  
 $H$  is the timebase of rate and is 1 for seconds, 60 for minutes, 3600 for hours and 86,400 for days.  
 $S$  is the Scaling Factor.

The Scaling Factor,  $S$ , is equal to the K-factor of the flowmeter expressed in pulses per unit volume.

The user programs the Scaling Factor and selects the timebase during the Calibration procedure as detailed in Section 5 of this manual.

## 10 Operation


### 3.2.2 Filtering

Frequency fluctuations caused by pulsating flow through a flowmeter, often makes the Rate impossible to read with any precision.

The Flow Computer has a digital filter which will average out these fluctuations and enable the Rate to be read to four digit accuracy. The degree of filtering is fully programmable which means that highly accurate and stable readings can be obtained without excessive lag.

When the Rate is retransmitted via the 4-20mA output, the filtering will also average out any fluctuations on the output.

The diagram below shows a pulsating signal input together with the effect of filtering.

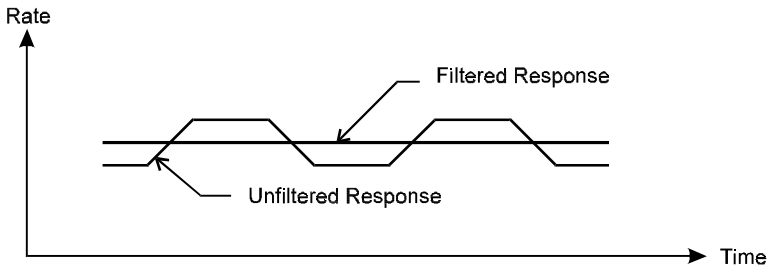

As a guideline to the degree of filtering to be used, the following table shows the response to a step change in input. The value, A, is the filter constant which is programmed during the Calibration routine. The times for the display value to reach 90% and 99% of full swing are given in seconds, for different values of A.

<b>A</b>	<b>90%</b>	<b>99%</b>
1	0	0
2	1	2
4	2	4
6	3	6
10	5	11
15	8	17
20	11	22
25	14	28
35	20	40
45	25	51
60	34	69
75	43	86
90	52	103
99	57	113

Table 1 - Response to a step Input (in seconds).

Note that if A is set to 1 there is no filtering of the input signal.

## 12 Operation

### 3.3 TOTAL CONVERSION

The Total Conversion feature enables the rate to be displayed in one engineering unit (eg. gallons/minute) and the totals to be displayed in another engineering unit (eg. barrels).

The Scaling Factor is always programmed in the unit relating to Rate, and the Total Conversion constant is a division factor which can be used to convert the totals to the different unit. The Total Conversion factor affects the net, accumulated and gross totals, and is limited between 0.01 and 2000.

#### For Example

If the Rate is required in gallons per minute:

1. The Scaling Factor would be programmed as pulses per gallon.
2. The timebase would be programmed as minutes.

If the Totals are required in barrels:

3. The Total Conversion factor is programmed as 42 (there are 42 gallons in a barrel). All totals will now totalise in barrels.

Some common units are given below together with the Total Conversion constant (TOTCON) which should be programmed.

Rate*	Totals	TOTCON
Gallons (US)/	Barrels (oil)	<u>42.000</u>
Litres/	Kilolitres	1000
ml/	Litres	1000
Mgallons/	Acre-feet	0.32587

\* Units per second, minute, hour or day. The timebase is programmed separately during Calibration.

### 3.4 THE OUTPUT PULSE (Model 405D Only)


An **OUTPUT PULSE** is available on terminal 10 for driving remote counters and produces a pulse each time the Accumulated Total increments by one digit. For example, if the Accumulated Total has a resolution of 0.01 gallons, a pulse is produced each 0.01 gallons.

The pulse is a current sinking pulse of approximately 10mSec produced by an open collector transistor and can sink up to 100mA. The maximum pulse rate is limited to 49 pulses per second and the resolution on the accumulated total must be set so that the accumulated total increments at less than 49 counts per second.


Note that due to the uneven pulse output spacing on this output, the pulse output cannot be used to drive rate indicators.

# 14 Operation

Connection of Output Pulse is as

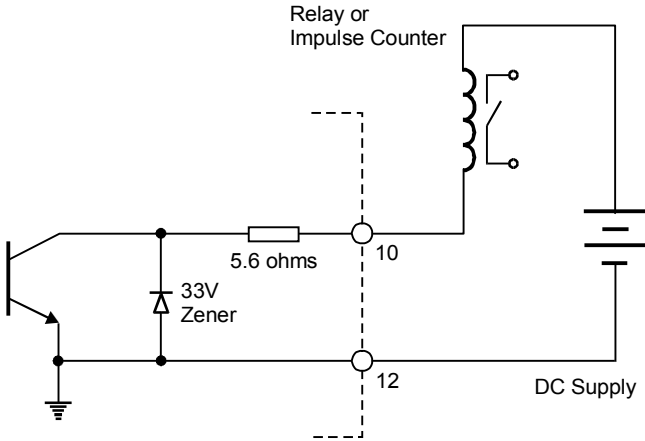

**Driving an External Relay or Impulse Counter**

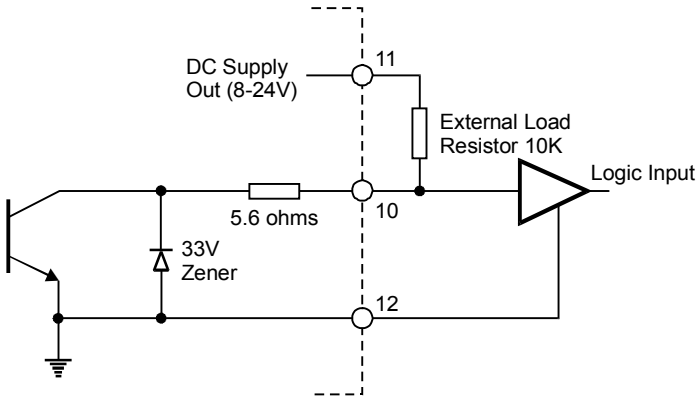

**Driving a Logic Input such as a PLC or Electronic Counter**



# 4. OPTIONS

NB. Version 3 Models Only

## 4.1 THE 4-20mA OUTPUT OPTION


The 4-20mA output option provides an analog output of rate as a 4-20mA current. All output signals are electrically isolated from the instrument power supply and signal inputs to ensure minimum interference. The 4-20mA is directly proportional to the displayed rate.

Either 2 wire current transmission is available with the loop powered internally, or 3 wire transmission from an external loop supply.

A block diagram of the output is shown below and various methods of interconnection are outlined on the following pages.

### NB. Diagram refers to Version 3 Models Only

**Version 3 Models can be defined by having plug-off green terminals**

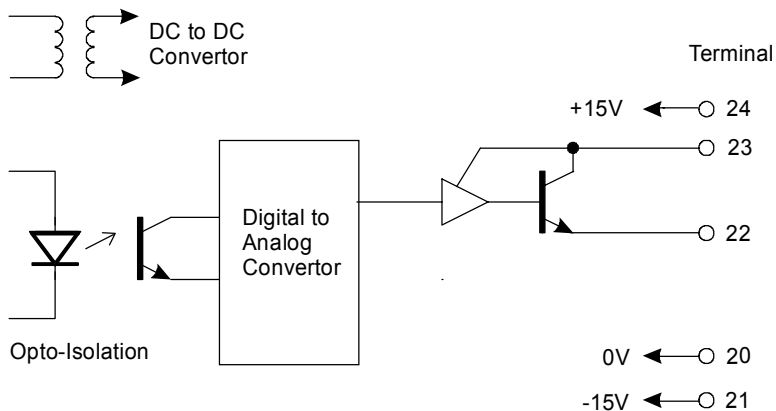

## 16 Options

### 4.1.1 Load Specification

Maximum load which the output can drive:

Internally powered loop: 500 ohms  
Externally powered:  $R = (V-5)/.02$   
where V is the external loop voltage  
R is the maximum load in ohms.

### 4.1.2 Calculation

Parameters relating to this option are programmed when calibrating the instrument (see section 5) and provide for:

- Defining the rate which is equivalent to 4mA or 0 volts.
- Defining the rate which is equivalent to 20mA or 10 volts.

By being independently able to set the output range, the instrument can effectively be programmed to amplify the input signal. In driving chart recorders, for example, this enables the output to zoom in on a particular operating area, instead of having to display the full operating range of the transducer.

For example, 4mA may be set as 0 litres/min and 20mA as 100/litres. However, the user could set 4mA as representing 100 litres/min and 20mA as representing 120 litres/min.


For rates or displayed values above and below the maximum and minimum values the output will remain at its 20mA or 4mA level respectively.

It should be noted that the output will be updated every 0.25 seconds in unison with the display and, between updates, the output value is constant. Also, only positive values of Rate are transferred to the analog output. The analog output

will remain at 4mA for all negative values of Net Rate.

**NB. Diagram refers to Version 3 Models Only**


Version 3 models can be defined by having plug-off green terminals.

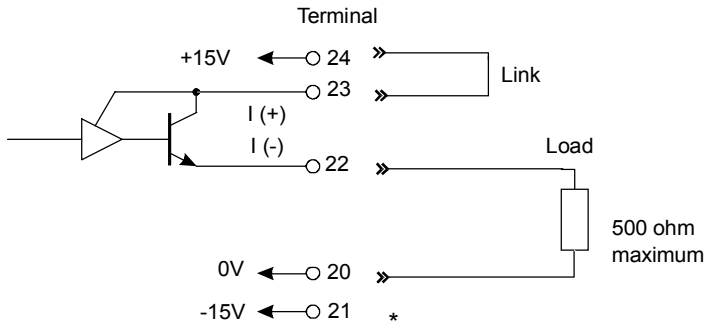

\* For driving high impedance loads (over 500 ohms), terminate to terminal 21

**Two Wire Transmission (Internal Supply)**

## 18 Options

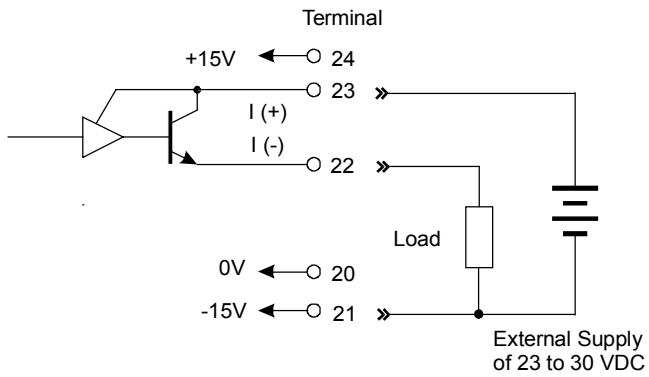

### Three Wire Transmission (External Supply)


## 4.2 THE RS232/422/485 INTERFACE OPTION

With this option installed, the circuits for both the RS232 and RS422/485 are provided as standard. They can be used to interface to both printers and computers, and a number of standard protocols are built into the instrument.

### 4.2.1 Hardware

The following diagram provides an overview of the RS232/RS422/RS485 communications hardware. All three interfaces are available on the rear terminal strips and the user can select either one by making the appropriate connections.

The RS232 interface is primarily used with printers or for simple communication with a computer over a short distance. The RS422 and RS485 interfaces are used for communication over a long distance or in applications requiring multipoint communication.

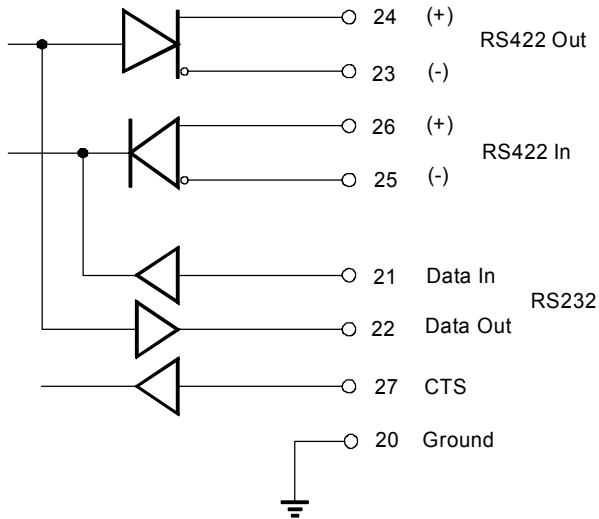

## 20 Options


### 4.2.2 Multipoint Communication

Multipoint Communication is a system whereby a number of instruments can be addressed over a dual twisted pair interface. Up to 32 instruments can be connected to a common bus using the RS422 and RS485 interfaces as shown below.


To convert the RS422 interface to an RS485 interface, the RS422 (-) Data In Terminal must be connected to the RS422 (-) Data Out Terminal and the RS422(+) Data In Terminal must be connected to the RS422 (+) Data Out Terminal.

These connections will convert the RS422 4 wire interface to the RS485 2 wire interface, as shown in figure 2.

Each instrument can be programmed with a unique address which is used by the Master Controller (ie IBM/PC) to identify each instrument. The Controller will send the address down the line and will alert the relevant instrument. Subsequent software protocol will control the flow of data between the Controller and the Instrument.

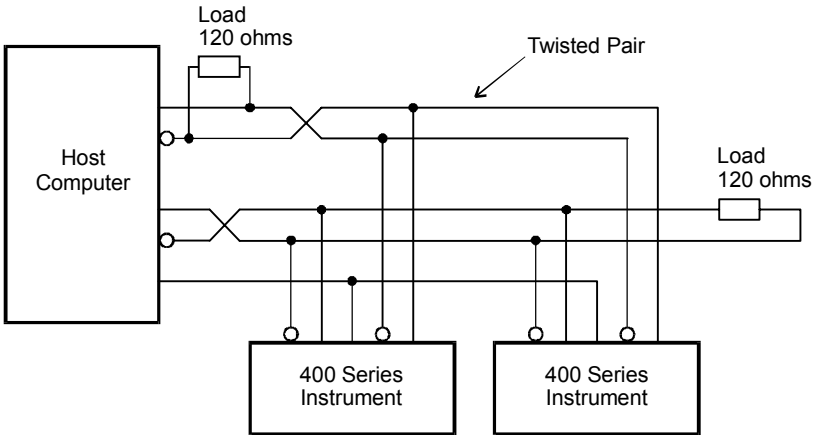

**Figure 1 RS422 Interface**

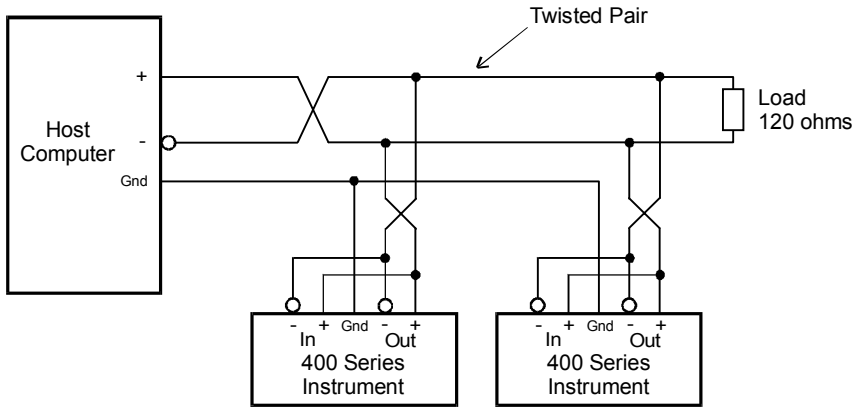

**Figure 2 RS485 Interface**

## 22 Options

### 4.2.3 Communication Protocol

The RS232/422/485 option has a real time clock and enables the time and date to be set and printed on tickets. The date format can be European (days/months/years) or USA (months/days/years) while the time is on a 24 hour clock.

Note that the clock will only retain its time for 3 days minimum if there is no power connected to the instrument. After this period, the clock may need to be reset.

**All new instruments are supplied with a 'pullout battery life protection tab' Please do not remove the tab until you are ready to install and apply power to the instrument.**

On latest models battery backup is provided. The battery will typically need replacing every two years or more frequently if extended power downs are a feature of the installation. Battery type is a CR2032 coin cell.

The baudrate, parity and word length can be programmed during calibration and the user must ensure that these correspond to the setting on the printer or computer with which the 405 is communicating.

The software protocols can be selected during Calibration to provide standard interfaces to a number of printers and computers. Since other interfaces will continue to be added, the user should consult the manual "*The RS232/422/485 Communications Option for the 400 Series, Version 2*", for the latest protocols and printer drivers.

#### **Printer**

A ticket is printed each time the RESET key is pressed. The instrument prints the ticket before resetting the resettable total. Protocols are provided to drive the following printers:

1. Standard Computer Printer  
(Note that the printer must have an RS232 Serial Interface)
2. EPSON CTM290 Slip Printer
3. Contrec Model 624
4. EPSON TM290-2 Slip Printer
5. Contrec Model 632-2
6. Syntest SP-210

The tickets can also be printed with a number of different units, including litres and gallons. The units are selectable from a pre-programmed list.



A CTS input is provided, and will prevent the instrument from transmitting any further characters to a printer if the printer buffer is full. The CTS input is usually connected to the "Data Buffer Full" output from the printer.

If the printer buffer is large enough to handle the message output from the instrument, then this input need not be used and should be left unconnected.

### **Computer**

The instrument receives and transmits messages in ASCII, with all command strings to the instrument terminated by a carriage return. While replies from the instrument are terminated with a carriage return and a line feed.

Xon/Xoff protocol is also supported, and the instrument will automatically determine if the message sent by the host computer is preceded by an Xoff character. If it does recognise an Xoff as the first character of a command string, the instrument will automatically switch to Xoff/Xon protocol, and begin & end all messages with Xoff and Xon characters respectively. Xoff/Xon protocol is only available when the RS232 interface is selected.

During Calibration, the instrument can be programmed to operate in a full duplex or half duplex transmission mode. In full duplex mode, all commands sent to the instrument will be echoed back to the host computer. In half duplex, the commands are not echoed.


For more information on the computer interface please consult the manual "*The RS232/422/485 Communications Option for the 400 Series, Version 2*".

## 24 Options

### 4.3 THE RELAY OUTPUT OPTION

The Relay output option consists of two Form C relays which can be preset during calibration to energise when the rate or displayed value exceeds or drops below the preset values.

The "low" relay is energised whenever the rate is below the preset value, and the "high" relay is energised whenever the rate exceeds the preset value. The preset values are programmed during calibration as described in section

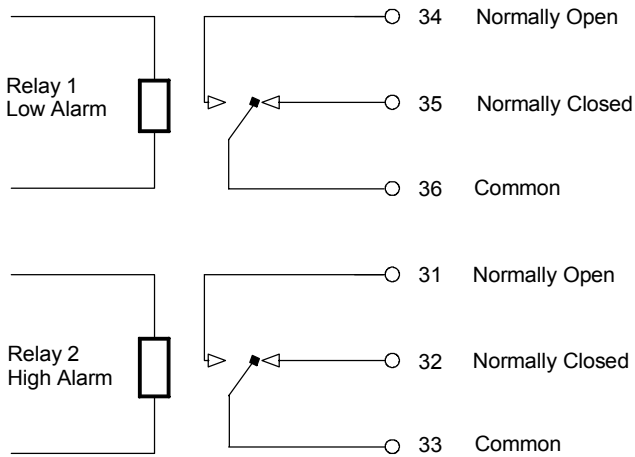

## 5. CALIBRATION

The Calibration routine enables the Setup Parameters to be programmed, as well as enabling the input signals to be checked.

The calibration routine can be entered in two ways:

- 1 By connecting a wire link (or switch) to the rear terminal strip across terminals 1 and 2
- or,
- 2 By pressing the TOTAL key and, while still holding, pressing the RESET key. Both keys must then be held for approximately 6 seconds. This second method of access can be disabled during the calibration so that it is only possible to enter the calibration routine via the link across terminals 1 and 2.

The key switch actions are as follows:

<b>RATE</b>	will change a flashing digit, to the next digit.
<b>TOTAL</b>	will increment a flashing digit or change a parameter selection.
<b>RESET</b>	will reset a flashing digit to zero.
<b>DISPLAY (Program)</b>	will step through the program sequences.

Note that the arrows in the Rate and Total key switches indicate that these switches can be used to change and increment digits respectively.

In stepping through the program sequence, the Parameter Description is always displayed first, followed by the actual value or parameter. When a value or parameter can be changed, it is always shown as flashing, and the LED's in the switch panels are lit if that key switch can be used to change a value.

## 26 Calibration

On first entering the Calibration routine, the display will show the Model number followed by:

<b>CAL</b>	Setup Program parameters.
<b>Options</b>	Options (if installed).
<b>Test</b>	Check Input Signals.
<b>End</b>	Exit to Normal Operation.

The user can toggle between these modes using the TOTAL switch and by using the DISPLAY switch, select the appropriate mode.

To exit Calibration, step through the Setup program or Test program until the end, and press the DISPLAY switch when **End** is displayed, (ensure the calibration link is removed).

**5.1 PROGRAMMING THE SETUP PARAMETERS**

<i>Step</i>	<i>Display</i>	<i>Description</i>	<i>Text Ref</i>
1	<b>CAL</b>	Select the Calibrate mode to setup program parameters.	5.2
	<b>OPTIONS</b>	Options (if installed).	5.3
	<b>TEST</b>	Select the test mode to check input signals.	
	<b>END</b>		
	<i>The following steps are displayed if CAL is selected.</i>		
2	<b>RESTOT</b>	Reset all totals to zero.	
	<b>xxxxxx</b>	To clear all totals (resettable total and accumulated) press the reset key.	
3	<b>SCALE</b>	Scaling Factor.	
	<b>Fact</b>	Enter the scaling factor(K-factor) of the flowmeter.	3.2
4	<b>F dPt</b>	Number of decimal points with which the Rate is to be displayed between 0 to	
	0.00000.		3.2.1
5	<b>t.base</b>	The Timebase with which the Rate is calculated must be entered as:	
	<b>60sec</b>	units/min	
	<b>s</b>	units/hour	
	<b>hours</b>	units/day	
	<b>days</b>	units/second	
	<b>secs</b>		3.2.2
6	<b>FILTER</b>	The filter constant for filtering the rate display and the 4-20mA output.	
	<b>1</b>	No filtering.	
	<b>to</b>	Very heavy filtering.	
	<b>99</b>		

## 28 Calibration

<i>Step</i>	<i>Display</i>	<i>Description</i>	<i>Text Ref</i>
7	<b>TOTCON</b>	A division factor to convert the totals to 3.3 different units from those used for rate (ie. gallons/min and barrels).	
	<b>1</b>	Rate and totals have the same engineering units.	
	<b>x.xxxx</b>	Other factors can be programmed between 0.01 and 2000.	
8	<b>t.dPt</b>	Number of decimal points with which the resettable total is displayed between 0 to 0.000.	
9	<b>A.dPt</b>	Number of decimal points with which the Accumulated (non resettable) total is displayed between 0 to 0.000.	
10	<b>ACCESS</b>	Enable access to calibration routine via the front keyboard only.	
	<b>Front</b>	Enable access via front keyboard.	
	<b>No Acc</b>	Disable access via front keyboard.	

**5.2 PROGRAMMING OPTIONS**

<i>Step</i>	<i>Display</i>	<i>Description</i>	<i>Text Ref</i>
1	<b>OPTIONS</b> <i>Test</i> <i>End</i> <i>CAL</i>	Options (if installed). Check the Input Signals. Exit to normal operation. Program Setup Parameters.	5.2  5.1
	<i>If the 4-20mA output option is installed, the following will be displayed:</i>		
2	<b>OUTPUT</b> <b>4-20</b> <b>0-10</b>	Select either 4-20mA 4-20mA (also 2-10 volts). 0-10 V (also 0-20mA).	4.1
3	<b>OP 4</b> <b>xxxx</b>	Flowrate at 4mA . Enter flowrate.	
4	<b>OP20</b> <b>xxxx</b>	Flowrate at 20mA	
	<i>If the RS232/422/485 option is installed, the following will be displayed:</i>		
5	<b>DF</b> <b>Eur</b> <b>USA</b>	Date Format. European (ie. days/months/years). USA (ie. months/days/years).	4.2
6	<b>Date</b> <b>xx:xx:xx</b>	Enter date as: Years:Months:Days.	
7	<b>HOUR</b> <b>xx:xx</b>	Enter time as a 24 hour clock. Hours:Minutes.	

### 30 Calibration

<i>Step</i>	<i>Display</i>	<i>Description</i>	<i>Text Ref</i>
8	<b>BAUD</b> <b>xxx</b>	Baudrate. 300, 600, 1200, 2400, 4800 and	
9	<b>DATA</b> <b>7</b> <b>8</b>	Word length. 7 bits.	4.
10	<b>PARITY</b> <b>NP</b> <b>OP</b> <b>EP</b>	Parity. No Parity. Odd Parity. Even Parity.	
11	<b>SIGNAL</b> <b>rs232</b> <b>rs422</b>	Signal Type. RS232. RS422/RS485.	
12	<b>ID NO</b> <b>0</b> <b>1-99</b>	Unit Identification Number. None.	
13	<b>PTYPE</b> <b>xx</b>  <b>00</b> <b>01</b> <b>02</b> <b>03</b> <b>04</b> <b>05</b>  <b>20</b>	Printer/Computer Type.  Standard Computer Printer. EPSON CTM 290 Slip Printer. Contrec Model 624 Printer. EPSON TM290-2 Slip Printer. Contrec Model 632-2 Printer. Syntest SP-210 Printer.  Computer.	



Step	Display	Description	Text Ref
------	---------	-------------	----------

*If a Printer Protocol is selected, the following message is displayed:*

13	<b>UNIT</b>	<b>xx</b>	Units of measurement printed.
		<b>00</b>	None.
		<b>01</b>	Litres (Ltrs).
		<b>02</b>	Gallons (Gals).
		<b>03</b>	Barrels (bbls).
		<b>04</b>	Pounds (lbs).
		<b>05</b>	Grams (gms).
		<b>06</b>	Kilograms (kgs).
		<b>07</b>	Tons (tons).

*If a Computer Protocol is selected, the following message is displayed:*

13	<b>ECHO</b>		ECHO Commands.
	<b>On</b>		Echo (Full Duplex).
			No Echo (Half Duplex).

*If the Relay Option is installed, the following will be displayed:*

14	<b>AL: Hi</b>		High Alarm switching point. The high relay will energise if the flowrate exceeds this value.	4.3
	<b>xxxxxx</b>			
15	<b>AL: Lo</b>		Low Alarm switching point. The low relay will energise if the flowrate falls below this value.	
	<b>xxxxxxx</b>			

## 32 Calibration

### 5.3 CHECKING THE INPUT SIGNAL

<i>Step</i>	<i>Display</i>	<i>Description</i>	<i>Text Ref</i>
1	<b>TEST</b>	Check the Input Signals.	
	<b>OPTIONS</b>	Options (if installed).	5.2
	<b>CAL</b>	Program Setup Parameters.	5.1
	<b>END</b>	Exit to normal operation.	

The following steps are displayed if **TEST** is selected.

- |   |                |   |
|---|----------------|---|
| 2 | <b>Sr x.xx</b> | Software revision number.<br>Displayed for 1 second followed by the actual frequency. |
| 3 | <b>Freq</b>    | Frequency in Hz.  |

*If the RS232/422/485 option is installed, the display will then show:*

- |   |             |                                   |
|---|-------------|-----------------------------------|
| 4 | <b>CLOC</b> | Clock.<br>Time in Hours:Mins:Sec. |
|---|-------------|-----------------------------------|

## 6. INPUT CIRCUITS

This section covers the connection of flowmeter signals for:

- Model 405D Flow Computer with input signal conditioning card.
- Model 405B Flow Computer with a basic signal input capability.

Both the Model 405D and 405B have a regulated output which can be used to power sensors. A trimpot on the rear of the instrument allows the voltage to be adjusted in the range of 8-24 Volts and the output can supply a maximum of 50mA.

### 6.1 INPUT CIRCUIT FOR THE MODEL 405D

The Model 405D has an input conditioning card which will accept signals from most pulse or frequency producing flowmeters. An 8 position DIL switch on the rear panel enables the input circuit to be configured for different signal types.

The input will interface directly to:

- Turbine Flowmeters
- Open Collector Outputs
- Reed Switches
- Logic Signals
- Two Wire Proximity Switches.

The following pages give examples of interconnection to various signal outputs, and a circuit diagram of the input is also provided.

### 34 Input Circuits

#### Switch Settings

The following switch settings are recommended for different input signal types.

Input Signal Type	Input Terminals CH1		Switch Settings							
	+	-	1	2	3	4	5	6	7	8
A. Logic Signal, CMOS,Pulse	9	8	off	off	off	off	on	off	off	off
B. Open Collector or Reed Switch	9	8	off	off	off	off	on	off	on	off
C. Namur Proximity (set DC out to 8 volts)	11	9	off	off	on	on	on	off	off	off
D. Switch or Reed Switch with debounce circuit	9	8	off	off	off	off	on	off	on	on
E. Coil (20m V P-P minimum)	9	8	off	on	off	off	off	off	off	off
F. Coil (low impedance) 22mV pp minimum	9	8	on	on	off	off	off	off	off	off

#### General Specification

Switching Threshold: 2.5 Volts (except for input type c, e and f)

Maximum Input Voltage: 50V peak

Input Impedance


Input type a: 100K

Input types b & d: 10K

Input type c: 1K

Input type e: 100K



Input type f: 2.4K

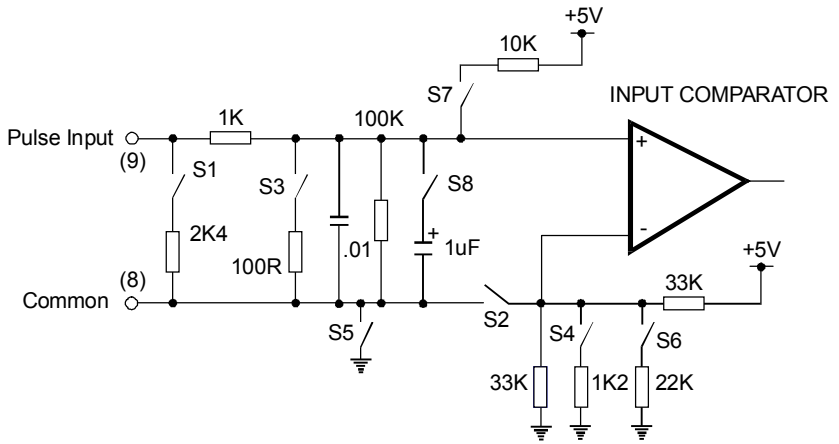

The Frequency Input Circuits

## 36 Input Circuits



### 1. Squarewave, CMOS or Pulse



**Model 405D**

eg. vortex,  
preamplifiers



### 2. Open-Collector



**Model 405D**

eg. hall  
effect



### 3. Reed Switch



**Model 405D**

eg. positive displacement  
flowmeters with reed



### 4. Coils

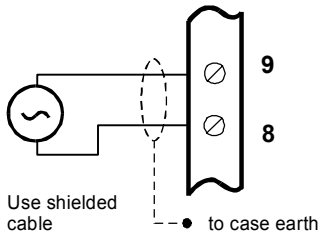

Model 405D

eg. millivolt signal from a turbine flowmeter (single input only)



### 5. Namur Proximity Switch



Model 405D

eg. positive displacement flowmeters with 2 wire proximity switch outputs

### 6. Opto-Sensors

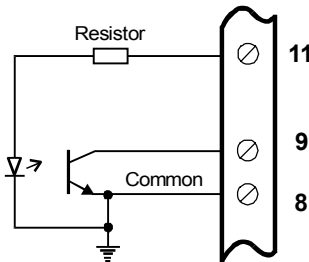

Model 405D

eg. preamplifiers and opto-sensors

Note that the current limiting resistor may be required. See the flowmeter manufacturer's data.

## 38 Input Circuits

### 6.2 INPUT CIRCUIT FOR THE MODEL 405B

The Model 405B will accept basic squarewave, pulse or open collector output signals, but is not able to read mV signals from coils, nor two wire proximity switch outputs. The Model 405B has limited input filtering and signal levels must switch between the levels specified below.

For open collector outputs, an internal 10K resistor will act as a load. However, the user must still ensure that the resulting signal will switch about the specified levels.

#### ***General Specification***

Signal Types: Squarewave, Pulse or Open Collector.


Signal Level: The "low" signal level must be < 1.5 Volts.

The "high" signal level must be > 3.0 Volts and must not exceed 30 Volts.


The input circuit for the Model 405B and installation examples are shown on the following pages.



The Input Circuit

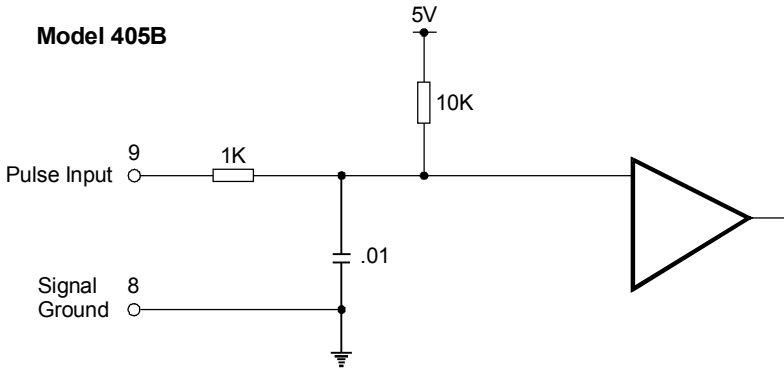


1. Squarewave or Pulse Inputs



Model 405B

eg. vortex or magnetic flowmeters

2. Open-Collector Inputs




Model 405B

eg. hall effect sensors

## 40 Input Circuits


### 3. Opto-Sensors

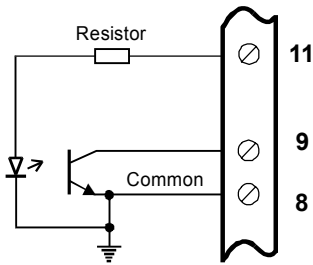

#### Model 405B

Note that the current limiting resistor may be required. See the flowmeter

### 4. Reed Switch




#### Model 405B

eg. positive displacement

6.3 REMOTE SWITCHES (Model 405D Only)

Remote push-buttons can be connected to the Model 405D to duplicate the switches on the front panel.

The switches are wired as follows:

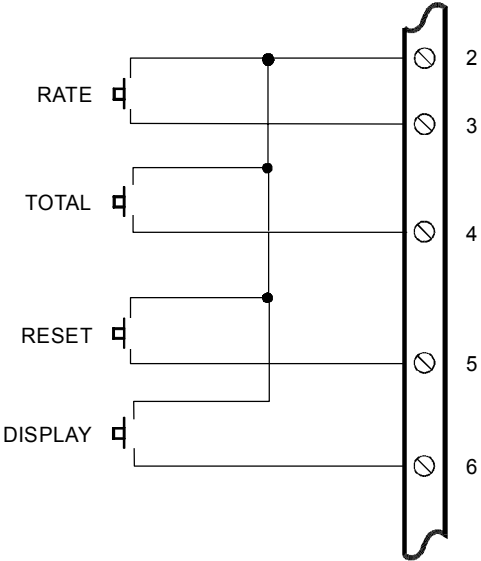

# 7. INSTALLATION

## 7.1 GENERAL

Terminal designations for the Models 405D and 405B Flow Computers are given on the following pages. The cutout hole in the panel should be 5.5" (139mm) wide x 2.6" (67mm) high. Two side clips are supplied to secure the instruments into the panel.

A case earthing point is provided via an earth lug on the side of the case. Note that this earthing point is for the case only and there is complete electrical isolation between this point and all electronic circuits. For EMC purposes, or when the instrument is connected to mains, this point must be connected to a good earth using a multi-stranded, braided wire or strap. All relay outputs are totally isolated from the case and from the internal circuitry.

A Supply Output voltage is provided to power sensors. This output will provide a regulated voltage of 8 to 24 volts and the voltage is adjustable by means of the potentiometer on the rear panel. Maximum current is 50mA and the instrument comes with the voltage factory set at 24 Volts. When the instrument is powered from a DC power source, the maximum output voltage on the Supply Output is the DC Input Voltage less 3.5 volts.

The instrument will operate from either 12-28 volts DC or from the mains. The mains voltage is factory set to either 95-135 VAC (110 VAC nominal) or 190-260 VAC (220 VAC nominal). An internal mains transformer provides full isolation between the mains and the electronic circuits.

The DC Ground terminal 12 provides a common ground for the 12-28 Volt power input, the 8-24 Volt output and the pulse output.

It is good practice to use shielded cables for all signal connections to the Model 405. Care must be taken to separate signal cables from power cables so as to minimise interference.

Overall shields should be connected to the case earth at the instrument end only.

This connection should be as short as possible and connected to the earthing lug on the side of the case.

In order to comply with the requirements for Electromagnetic Compatibility as per EMC-Directive 89/336/EEC of the Council of European Community, this wiring practice is mandatory.

Although it is also possible to connect shields to the signal ground (terminal 2) this practice is not in accordance with EMC directives.

### ***RC Networks for Interference Suppression***

When driving highly inductive loads with the relay outputs, it is recommended that RC suppression networks (often called "Snubbers") are used for two reasons:

- To limit the amount of electrical noise caused by arcing across the contacts which may, in extreme cases, cause the microprocessor to act erratically.
- To protect the relay contacts against premature wear through pitting.

RC suppression networks consist of a capacitor and series resistor and are commonly available in the electrical industry. The values of R and C are dependant entirely on the load. However, if the user is unsure of the type of snubber to use, values of 0.25uF and 100 ohms will usually suffice. Note that only mains rated, UL approved RC suppression networks should be used.

The basic principle of operation is that the capacitor prevent a series of sparks arcing across the contact as the contact breaks. The series resistor limits the current through the contact when the contact first makes.

## 44 Installation

### 7.2 WIRING DESIGNATIONS FOR THE 405D & 405B

<b>Terminal</b>	<b>Model 405D</b>	<b>Model 405B</b>
1	Calibration Link	Calibration Link
2	Signal Ground	Signal Ground
3	Rate Switch	Not To Be Used
4	Total Switch	Not To Be Used
5	Reset Switch	Not To Be Used
6	Program Switch	Not To Be Used
7	Not To Be Used	Not To Be Used
8	Flow Common (-)	Flow Common (-)
9	Flow Pulse Input	Flow Pulse Input
10	Pulse Out	Not To Be Used
11	DC Power Out (8-24 VDC)	DC Power Out (8-24 VDC)
12	DC Ground	DC Ground
13	DC Power Input	DC Power Input
14	Not To Be Used	Not To Be Used



<b>Terminal</b>	<b>Analog Flow Output</b>	<b>RS232/422/485</b>
20	0 Volts	RS232 Signal Ground
21	-15V	RS232 Data In
22	I (-)	RS232 Data Out
23	I (+)	RS422/485 (-) Data Out
24	+15V	RS422/485 (+) Data Out
25	DC Ground	RS422/485 (-) Data In
26	Not To Be Used	RS422/485 (+) Data In
27	Not To Be Used	RS232 CTS

<b>Terminal</b>	<b>Relay Option</b>
2B	Signal Ground
31	Relay 2 - Normally Open
32	Relay 2 - Normally Closed
33	Relay 2 - Common
34	Relay 1 - Normally Open
35	Relay 1 - Normally Closed
36	Relay 1 - Common


### 7.3 EX 410 ENCLOSURE DIMENSIONS

(all dimensions in mm)


**Ex 410 Enclosure with 5 Keys**

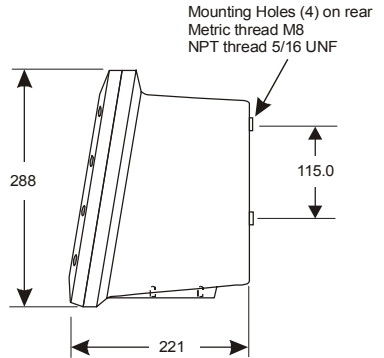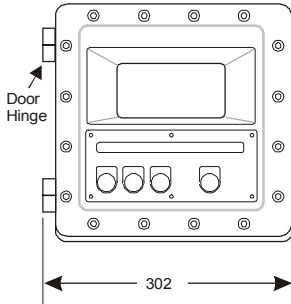

**Bottom View**

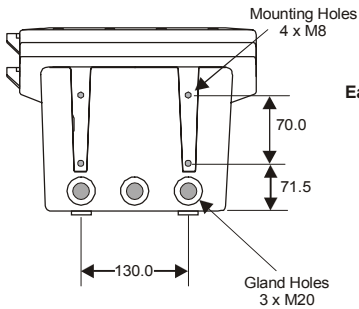

**Enclosure with 3 x M20 Gland holes**

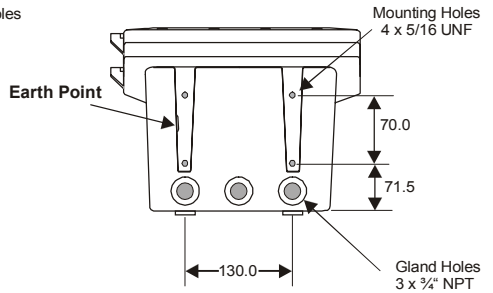

**Enclosure with 3 x 3/4" NPT Gland holes**

Material: Cast Aluminium  
Finish: Light beige powdercoat

## 8. TROUBLE SHOOTING

### 8.1 ERROR CODES

The instrument has extensive self test facilities and will display an error code if it detects an invalid condition. If the instrument displays an error code other than those listed below, please contact the factory.

Error codes are displayed as "Err 12" and a list of commonly encountered codes are given below:

#### ***Error Codes***

##### *Input Errors*

- 11 Invalid input configuration programmed.
- 14 Communications Input error (RS232/422/485 Interface).

##### *Output Errors*

- 21 Invalid output configuration.
- 22 Communications error - Baud rate not set.
- 23 Communications error - Printer fault.

##### *Calibration Errors*

- 30 Zero Value not allowed.
- 33 Invalid Printer Type.
- 34 Invalid Volume Units selected.



# Index

4-20mA Output, 15

## A

Access, 28  
Accumulated Total, 8

## B

Battery, 22  
Baudrate, 22

## C

Calibration, 25  
Chart Recorders, 16  
Clock, 22  
Communication Protocol, 22  
Communications, 19  
Computer, 23  
Cutout, 5

## D

Date, 22  
Decimal Points, 28  
Dimensions, 5  
Display Key, 8

## E

Earth Lug, 42  
Earthing Point, 42  
Electrical Noise, 43  
Error Codes, 46  
Ex 410 Enclosure, 45

## F

Filtering, 10  
Frequency Input, 9  
Frequency Range, 5  
Front Panel, 8

## G

Ground, 42

## I

Inductive Loads, 43  
Input Circuits, 33  
Input Impedance, 34  
Installation, 42  
Interference, 43  
Isolation, 42

## K

K-factor, 9

## L

Logic Signals, 33

## M

Mains Voltage, 42  
Maximum Input Voltage, 34  
Model Number, 4  
Multipoint Communication, 20

## N

Namur Sensors, 33  
Non-volatile Memory, 8

## O

Open Collector Outputs, 33  
Operating Temperature, 5  
Operation, 7  
Options, 15  
Opto-Sensors, 37  
Output Pulse, 13

## P

Parity, 22  
Power Requirements, 5  
Printer, 22  
Pulsating Signal, 10  
Pulse Output, 13

## R

Reed Switches, 33  
Regulated Voltage, 42  
Relay Output, 24  
Remote Push-buttons, 41  
Response, 11  
RS232/422/485 Interface, 19

## S

Scaling Factor, 9  
Scaling Range, 5  
Self Test, 46  
Setup Parameters, 25  
Snubbers, 43  
Specification, 5  
Supply Output, 42  
Switch Settings, 34  
Switching Threshold, 34

## 48 Index

### T

Terminal, 44

Terminal

Designations, 42

Tickets, 22

Time, 22

Timebase, 9, 27

Total Conversion, 12

Transducer Supply, 5

Trouble Shooting, 46

Turbine Flowmeters, 33

### W

Wiring Designations,  
44

Word Length, 22